


DETAIL 02713-3

COBB COUNTY WATER SYSTEM

FIRE HYDRANT INSTALLATION (ROADWAY STANDARD)

AUGUST 7, 2001

AGENCY DIRECTOR

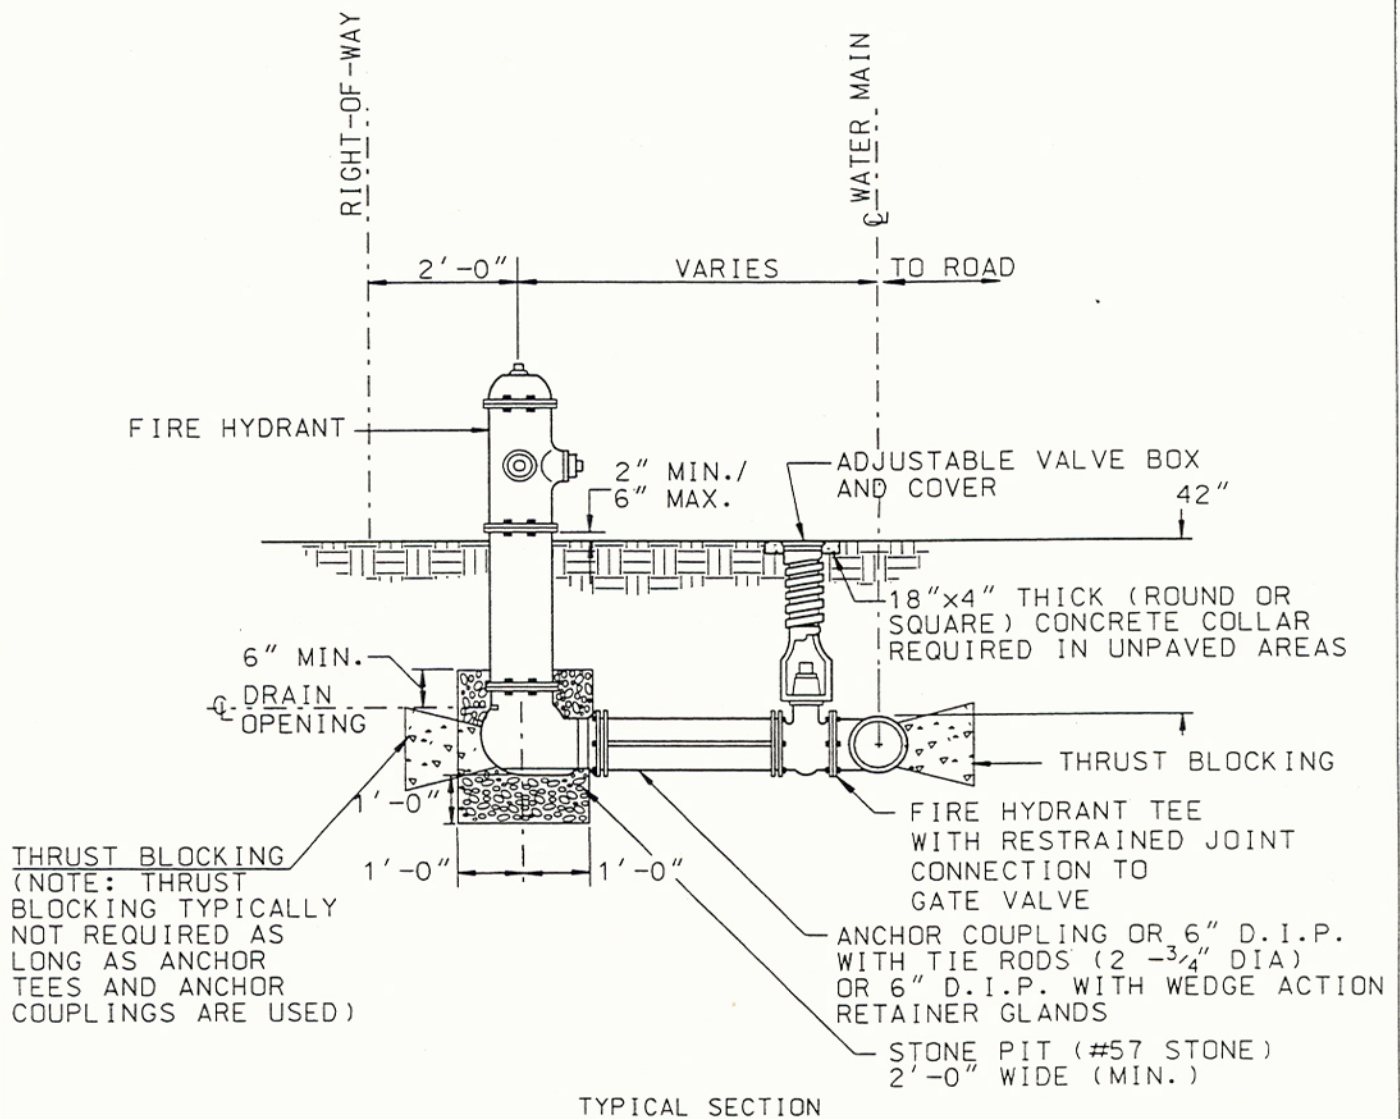

- NOTES:
1. TIE RODS TO BE ALLOY STEEL WITH MIN. TENSILE STRENGTH OF 125,000 P.S.I.. RODS TO BE COATED WITH BITUMINOUS PAINT AFTER INSTALLATION.
 2. WEDGE ACTION RETAINER GLANDS SHALL BE EBAA IRON MEGALUG, FORD UNI-FLANGE SERIES 1400, OR EQUAL.